

CONTROL PANEL
(SEE SPECIFICATIONS)

METER BY
OWNER

METER SOCKET BY CONTRACTOR
SHALL BE 200 AMP LEVER BYPASS 4
DRAW METER CABINET.
CONTRACTOR TO CONTACT NPU
ELECTRICAL INSPECTOR PRIOR
TO INSTALLATION

ONE 4" PVC CONDUIT
TO UTILITY POLE
(ELECTRIC)

ONE 2" PVC CONDUIT
TO UTILITY POLE
(TELEPHONE)
TWO LENGTHS PVC
AT WEATHERHEAD

ONE 1" GALVANIZED STEEL
CONDUIT TO WET WELL


CONCRETE PAD
SEE DETAIL

1-1/2" PVC CONDUIT
TO GENERATOR

1-1/2" PVC CONDUIT
TO GENERATOR

2-1/2" PVC CONDUIT
TO WET WELL

2-1/2" PVC CONDUIT
TO WET WELL

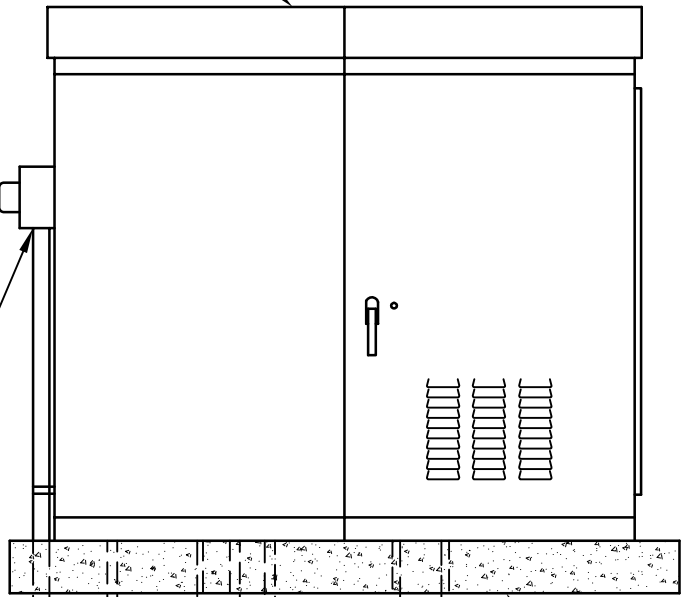

Dwg. No. PS-3		Sanitary Sewer Pump Station Control Panel			Date: May 2014
Revision	Date	Drawn	Scale	Description	
Sanitary Sewer Construction Standards				Norwich Public Utilities	